

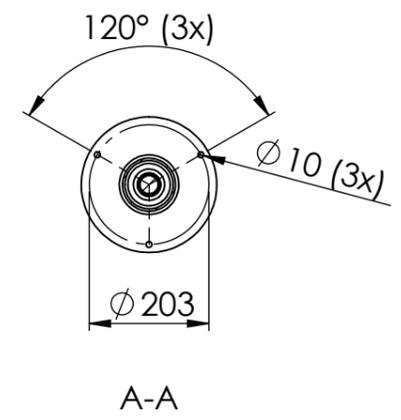
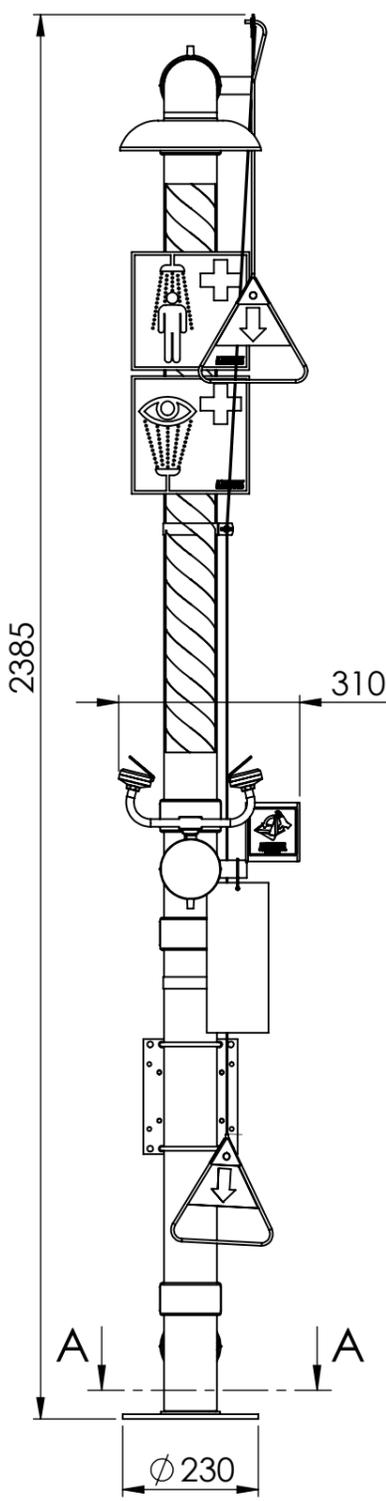


This document must not be copied without our written permission, and the contents thereof must not be imparted to a third party nor be used for any unauthorized purpose. Contravention will be prosecuted.

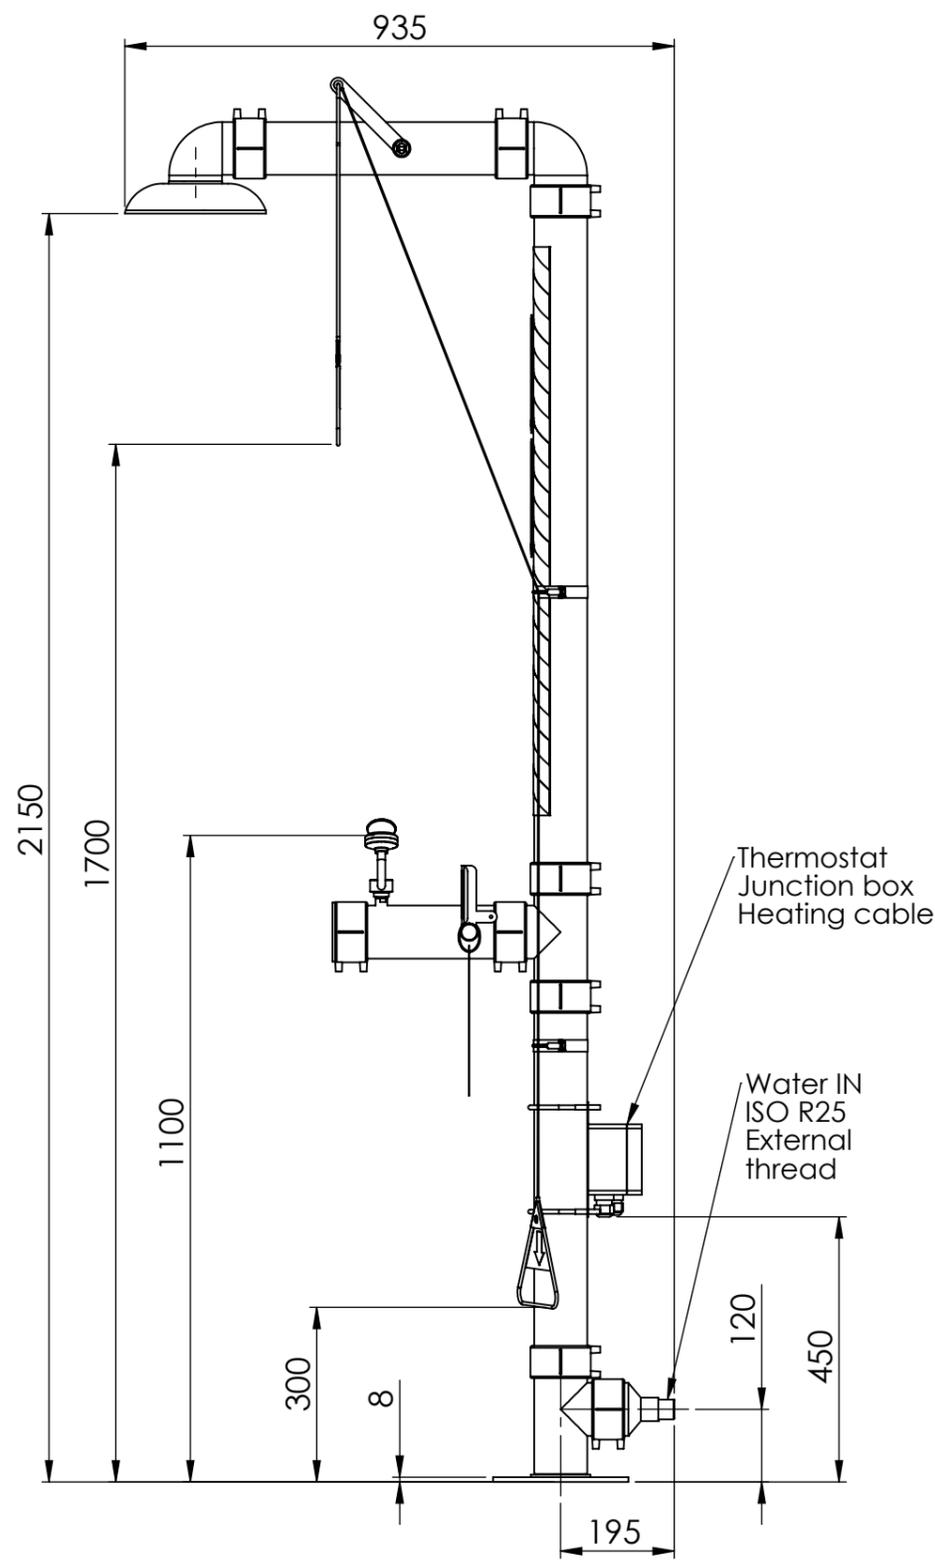

General information:
Power consumption 230 VAC, 50Hz, 6A

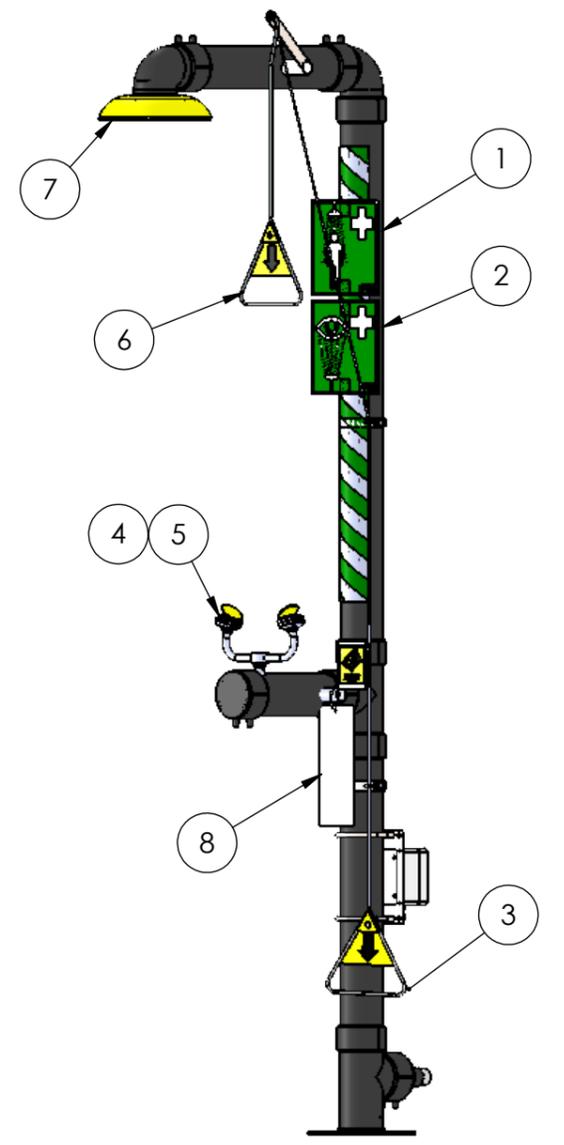

Pos	Quantity	Order number	Description
8	1	KND549	Control card
7	1	KND530	Shower head, stainless steel
6	1	KND532	Pull rod, stainless steel
5	2	KND508	Filter to spray head, 14 litres/minute
4	2	KND507	Spray head, 14 litres/minute
3	1	KND540-100	Pull rod for disabled person
2	1	KND545	Emergency sign, eye wash
1	1	KND547	Emergency sign, shower

Rev.	Description	Date	Sign.
3	Draeing updated	2019-05-22	MM
2	Drawing update	2017-11-24	MM
1	Drawing update	2017-10-02	MM

Owner	Prepared by MM	Approved by DK	Date 2017-10-02	Scale 1:12	
Krusman EMERGENCY SHOWERS		Title Emergency shower 3819		Drawing No. R3819	
Phone: +46-(0)21-14 92 00 Website: www.krusman.com		Description Insulated and heated combination shower		Rev. 3	Sheet 1 (1)
		Installation drawing			